


STANDARD FILTER TERMINAL DETAILS


-S (Studs)

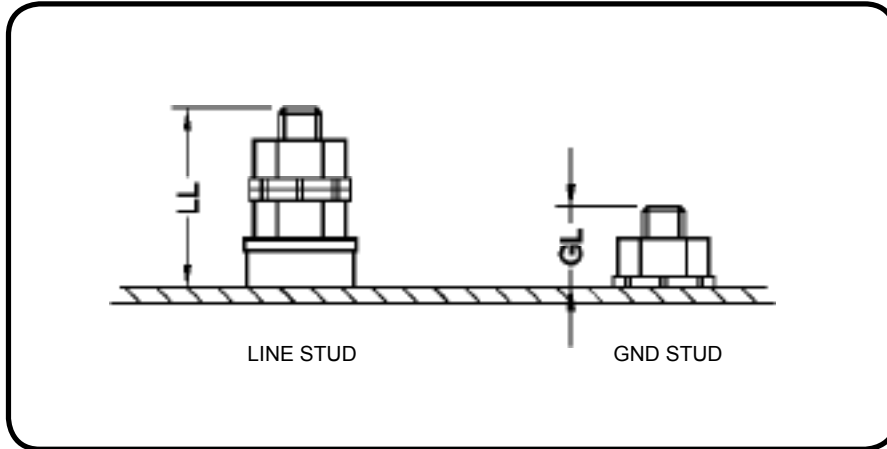


STUD SIZE	NOMINAL LENGTH SINGLE PHASE		NOMINAL LENGTH THREE PHASE		RECOMMENDED TORQUE	
	LINE (LL)	GND (GL)	LINE (LL)	GND (GL)	IN-LB	NM
M4/ 832	18	12	25	12	12	1.3
M5/ 1032	18	12	25	12	19	2.1
M6/ 1/4	25	12	30	12	35	4
M8/ 5/16	25	12	30	12	90	10
M10/ 3/8	38	23	38	23	160	18
M12/ 1/2	45	23	45	23	265	30

Note: Line studs are plated brass. Ground studs are typically plated Steel.

-QD

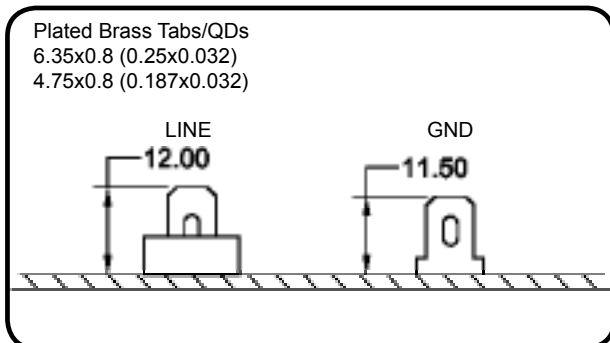

-W

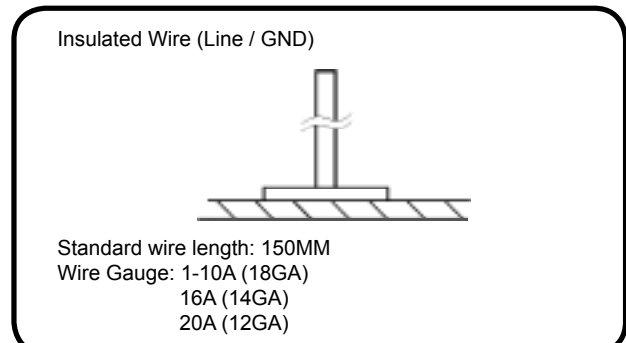

www.radiuspower.com
www.astrodyne.com

Email: Emifiltercs@astrodyne.com